


NOTE: Shut-off valve in service box. Open faucet on fountain and pump air through sniffer valve for winter shut down.

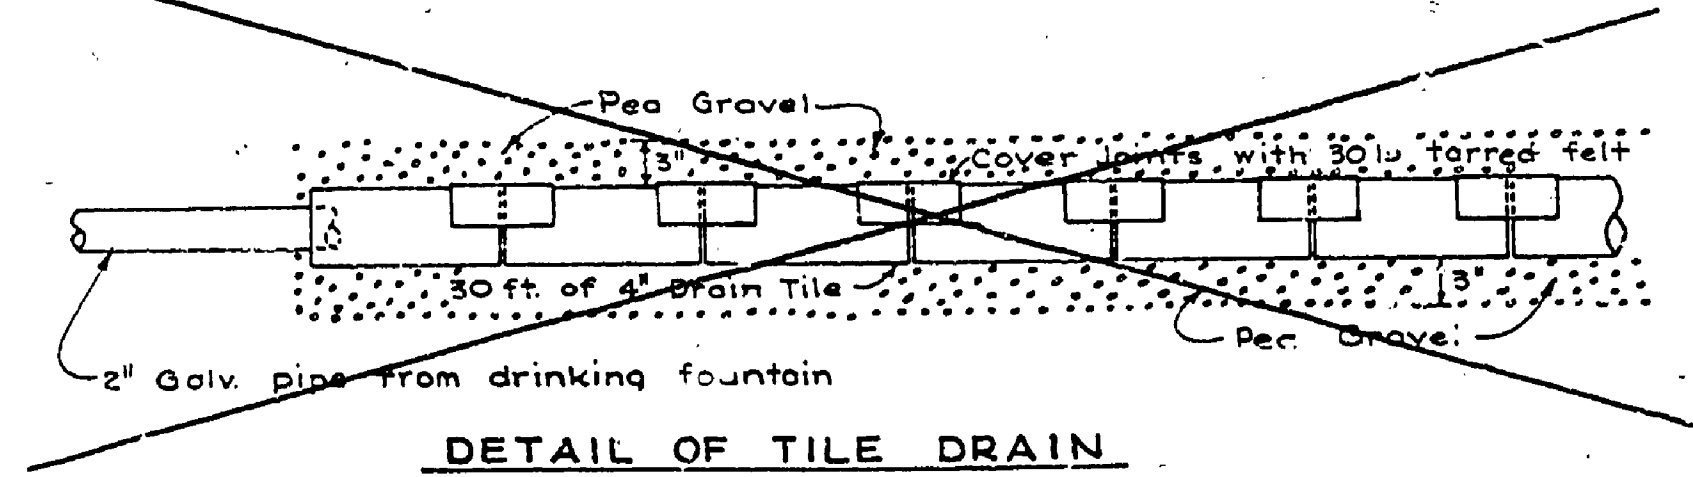

SURVEYED BY		DRAWN BY		SEPT. '60	NO.	DATE	BY	REVISIONS		NO.	DATE	BY	REVISIONS		MICHIGAN DEPARTMENT OF CONSERVATION		DRINKING FOUNTAIN PLAN AND PITLESS ADAPTER TANK		SHEET NO. OF	YANKEE SPRINGS REC AREA GUN LAKE SECTION	
BARKER		COTE		9-6-59	1.	6-60	HLR	Extension Type Service Box in Slab		3.									3	OF 3	
DATE		CHECKED BY		DATE	2.	8-69	JWH	Tank Construction & Casing		4.										PLAN NO E-146	

SE-149