


DATE	BY	REVISIONS
9-23-51	PAH	1
10-14-51	J.T.R.	2
10-14-51	J.T.R.	3
10-14-51	J.T.R.	4
10-14-51	J.T.R.	5
10-14-51	J.T.R.	6

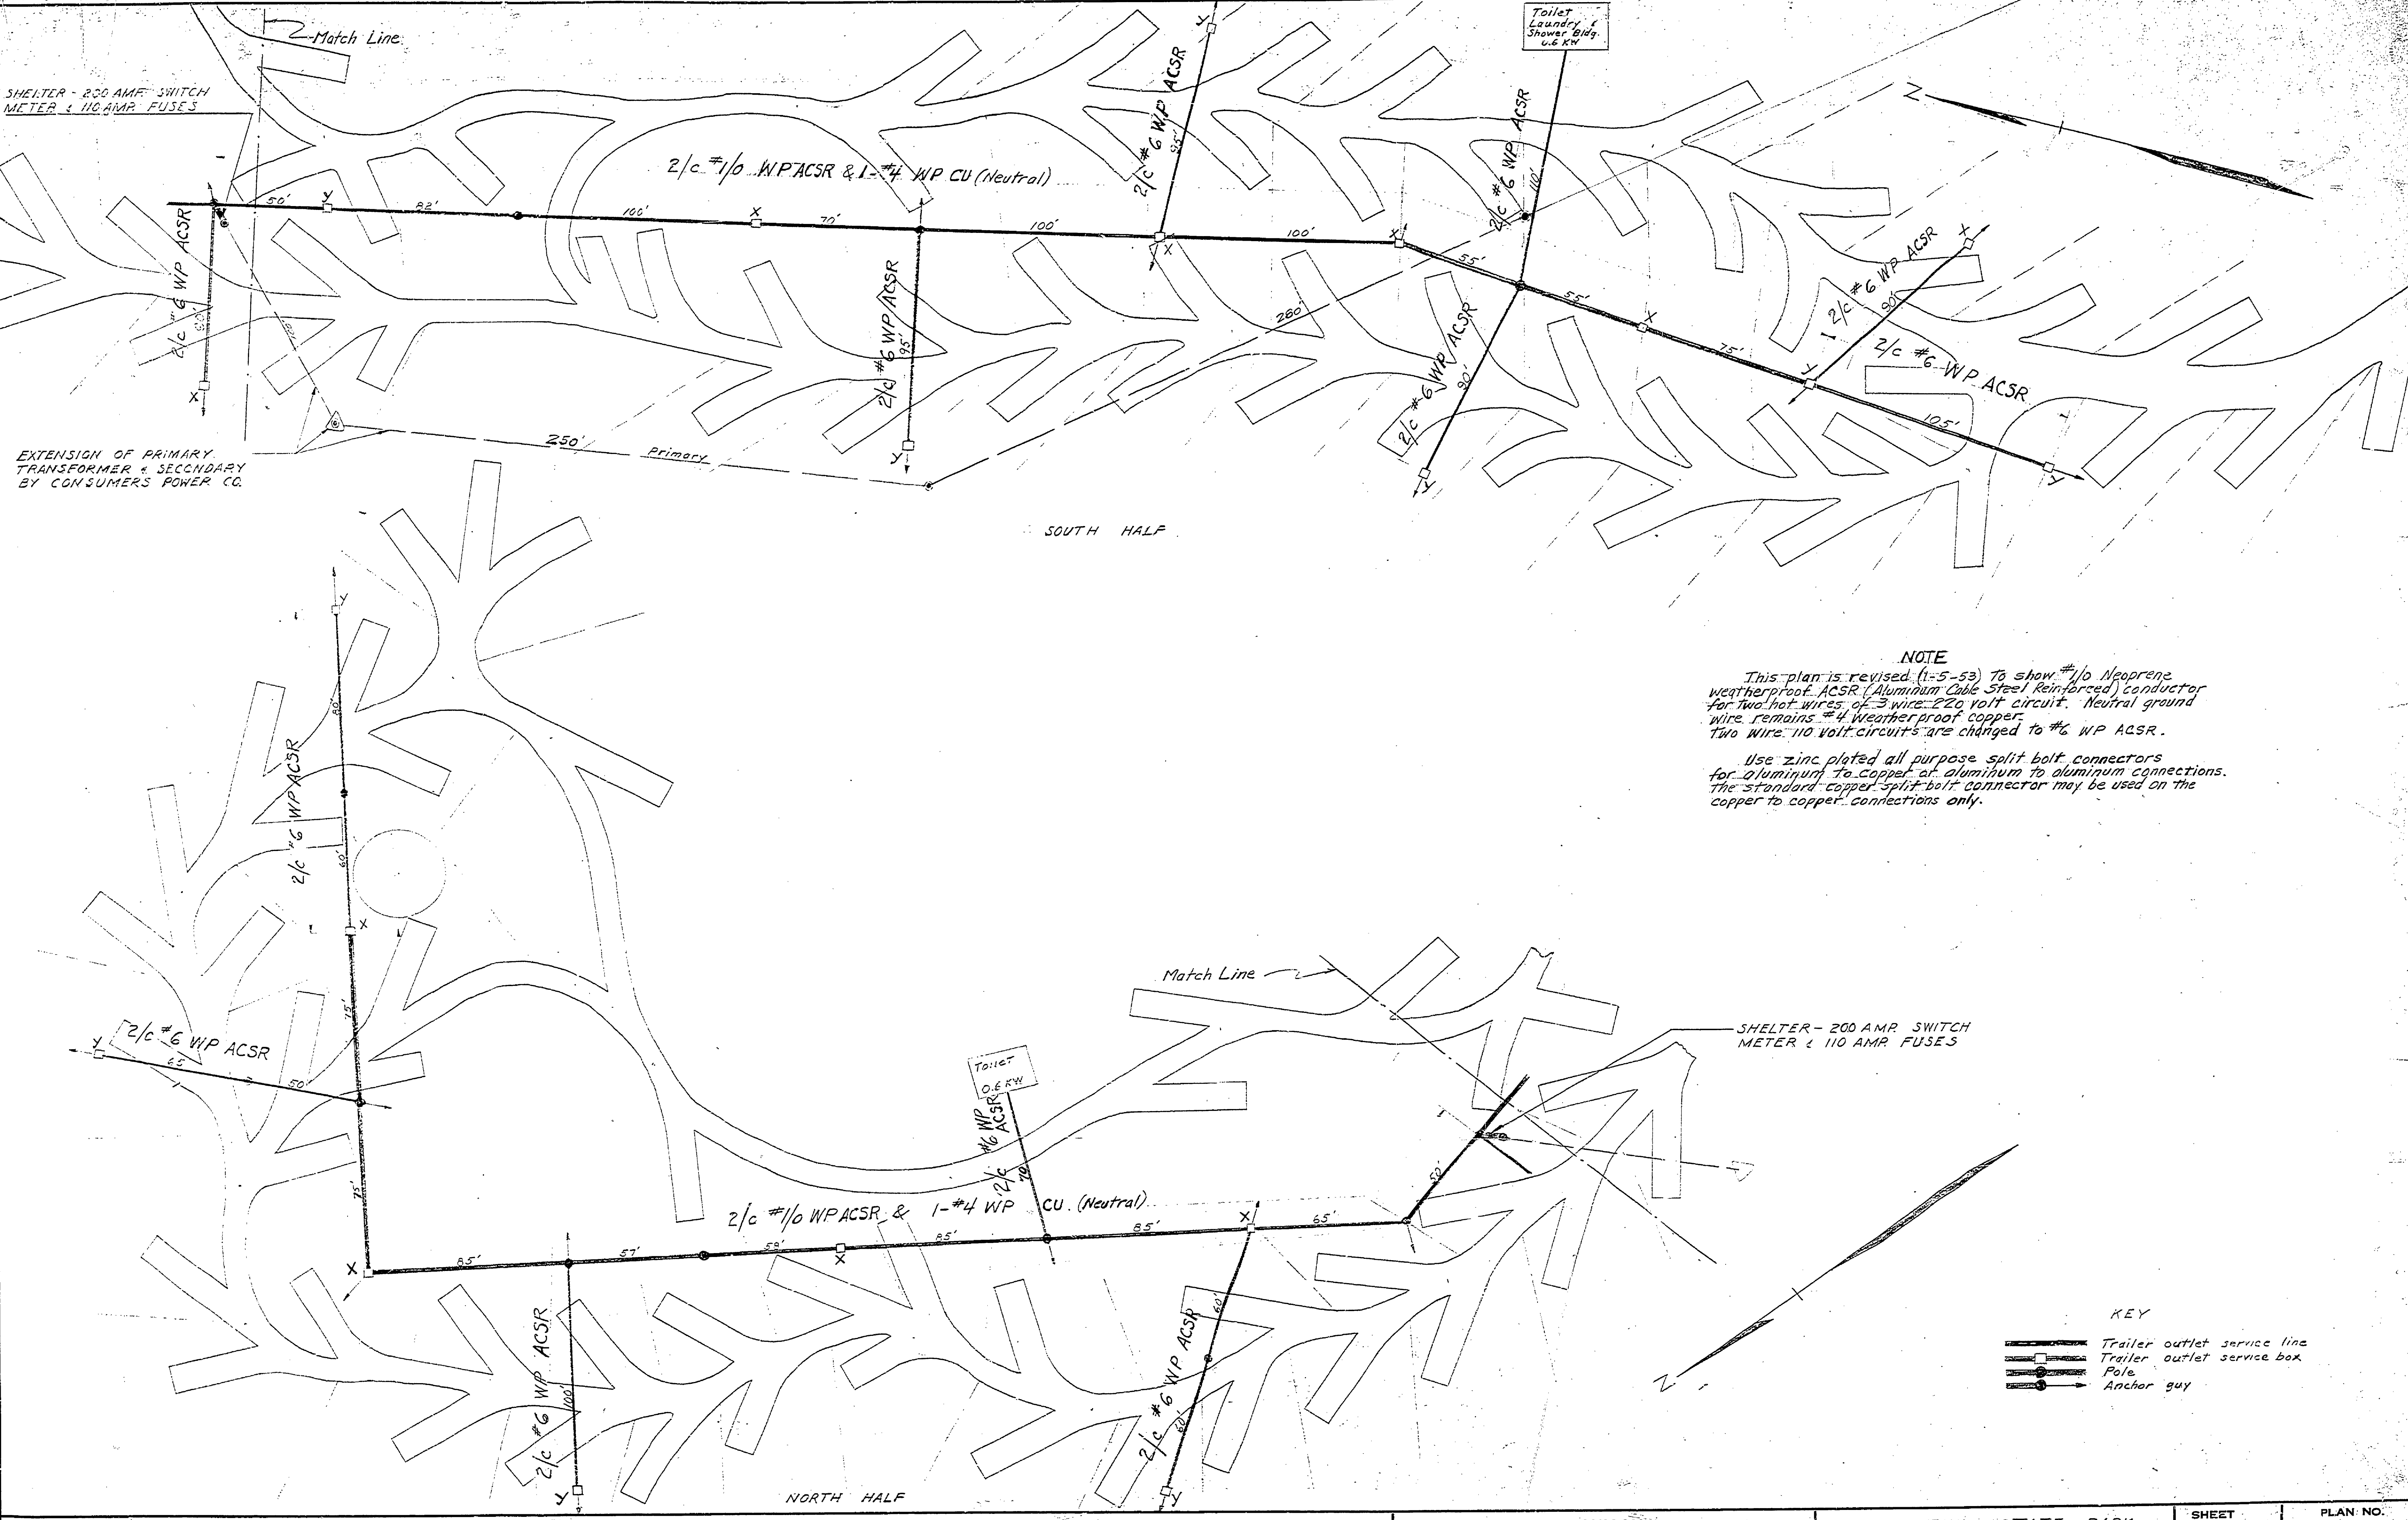

**NOTE**  
 This plan is revised (1-5-53) to show #10 Neoprene weatherproof ACSR (Aluminum Cable Steel Reinforced) conductor for two hot wires of 3 wire 220 volt circuit. Neutral ground wire remains #4 weather proof copper. Two wire 110 volt circuits are changed to #6 WP ACSR.  
 Use zinc plated all purpose split bolt connectors for aluminum to copper or aluminum to aluminum connections. The standard copper split bolt connector may be used on the copper to copper connections only.

**KEY**

	Trailer outlet service line
	Trailer outlet service box
	Pole
	Anchor guy

PINES CAMPGROUND Upper View - South Half  
 Lower View - North Half

MICHIGAN DEPARTMENT OF CONSERVATION  
 PARKS AND RECREATION DIVISION

LUDINGTON STATE PARK  
 ELECTRICAL DISTRIBUTION SYSTEM  
 Scale 1"=30'

SHEET NO. 1	PLAN NO. E-115
OF 1	